


## **Three-Compartment Sink Procedures**

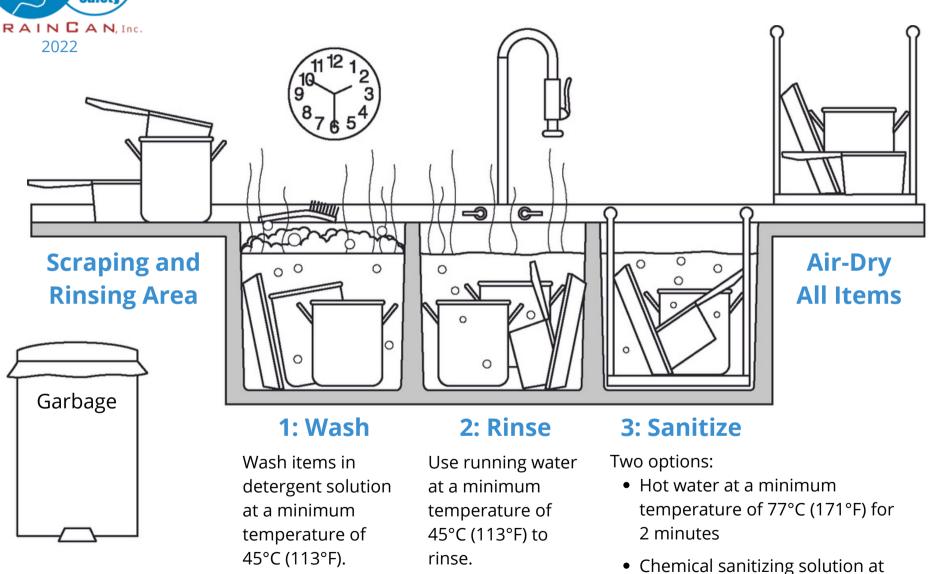

the proper temperature mixed to specifications for 2 minutes